



# Fire assessment report




Fire hazard properties of veneered Flameblock™ FR MDF

Client: Briggs Veneers Pty Ltd

Job number: 23754 Revision: R5.0

Issue date: 16 May 2019 Expiry date: 31 May 2024

## Amendment schedule

| Version | Date                            | Information relating to report |   |   |   |
|---------|---------------------------------|--------------------------------|---|---|---|
| R0.0    | Issue:<br>28 September<br>2009  | Reason for<br>issue            | First issue   |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   |   |
|         | Expiry:<br>30 September<br>2009 | Name                           | K.G. Nicholls   | S. Kettle   |   |
|         |                                 | Signature                      |   |   |   |
| R1.0    | Issue:<br>28 February 2014      | Reason for<br>issue            | Inclusion of additional veneers and substrate                                       |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   |   |
|         | Expiry:<br>28 February 2019     | Name                           | K. G. Nicholls  | D. Nicholson  |   |
|         |                                 | Signature                      |   |   |   |
| R2.0    | Issue:<br>10 March 2019         | Reason for<br>issue            | Inclusion of nominal density for the Flameblock™ substrate                          |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   |   |
|         | Expiry:<br>28 February 2019     | Name                           | K. G. Nicholls  | D. Nicholson  |   |
|         |                                 | Signature                      |   |   |   |
| R3.0    | Issue:<br>9 March 2016          | Reason for<br>issue            | Revision to product name, referenced reports and inclusion of additional veneers    |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   |   |
|         | Expiry:<br>28 February 2019     | Name                           | K. G. Nicholls  | D. Nicholson  |   |
|         |                                 | Signature                      |   |   |   |
| R4.0    | Issue:<br>15 April 2016         | Reason for<br>issue            | Revised with typographical correction   |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   |   |
|         | Expiry:<br>28 February 2019     | Name                           | K. G. Nicholls  | D. Nicholson  |   |
|         |                                 | Signature                      |   |   |   |
| R5.0    | Issue:<br>16 May 2019           | Reason for<br>issue            | Revalidation in accordance with AS 5637.1:2015                                      |   |   |
|         |                                 |                                | Prepared by   | Reviewed by   | Approved by   |
|         | Expiry:<br>31 May 2024          | Name                           | Tanmay Bhat   | Anthony Rosamilia   | Kjetil Pedersen   |
|         |                                 | Signature                      |  |  |  |

## Contact information

Warringtonfire Australia Pty Ltd – ABN 81 050 241 524

**Melbourne – NATA registered laboratory**

Unit 2, 409-411 Hammond Road  
Dandenong South, VIC 3175  
Australia

T: +61 3 9767 1000

**Brisbane**

Suite 6, Level 12  
133 Mary Street  
Brisbane, QLD 4000  
Australia

T: +61 7 3238 1700

**Perth**

Unit 22, 22 Railway Road  
Subiaco, WA 6008  
Australia

T: +61 8 9382 3844

**Sydney**

Suite 802, Level 8  
383 Kent Street  
Sydney, NSW 2000  
Australia

T: +61 2 9211 4333

**Canberra**

Unit 2, 11 Murray Crescent  
Griffith, ACT 2603  
Australia

T: +61 2 6260 8488

## General conditions of use

This report may only be reproduced in full without modifications by the report sponsor. Copies, extracts or abridgments of this report in any form shall not be published by other organisations or individuals without the permission of Warringtonfire Australia.

Warringtonfire Australia is not at liberty to discuss the contents of this report with third parties without the consent of the report sponsor(s).

All work and services carried out by Warringtonfire Australia are subject to, and conducted in accordance with, the Standard Terms and Conditions of Warringtonfire Australia, which are available at <https://www.element.com/terms/terms-and-conditions> or upon request.

Exova Warringtonfire rebranded to Warringtonfire on 1 December 2018. Apart from the change to our brand name, no other changes have occurred. The introduction of our new brand name does not affect the validity of existing documents previously issued by us.

## Executive summary

This report presents an assessment on the likely fire hazard properties of veneered Flameblock™ FRMDF in accordance with AS 5637.1:2015 and “C/VM2 (Amendment 5) – Verification Method: Framework for Fire Safety Design” of the New Zealand building code. Multiple ISO 9705 room burn tests were conducted on hardwood and softwood veneer species bonded to a Flameblock™ FRMDF. The results from these tests were then applied to predict the likely performance of a range of veneers, as summarized in Table 1.

**Table 1 Assessed fire hazard properties of timber veneers bonded to a 12-25 mm thick Flameblock™ FRMDF substrate**

| Veneer Type                     | Maximum Density (kg/m <sup>3</sup> ) | Maximum Thickness (mm) | Group Number |
|---------------------------------|--------------------------------------|------------------------|--------------|
| Natural timber                  | 755                                  | 0.6                    | 2            |
| TrueGrain™ reconstituted dyed   | 415                                  | 0.55                   | 2            |
| TrueGrain™ reconstituted undyed | 755                                  | 0.6                    | 2            |
| Tabu/Woodstock/Eclogna™ dyed    | 755                                  | 0.6                    | 2            |

All veneer species with a density up to 755 kg/m<sup>3</sup> bonded to a Flameblock FRMDF™ (12-25 mm thick) are likely to achieve Group 2. The raw Flameblock™ FRMDF with no veneers are also likely to achieve Group 2. The variations and outcome of this assessment are subject to the limitations and requirements described in section 4 of this report. The results of this report are valid until 30 April 2024.

## Contents

|  |    |
|--|----|
| Amendment schedule .....                                   | 2  |
| Contact information .....                                  | 3  |
| General conditions of use .....                            | 3  |
| Executive summary .....                                    | 4  |
| Contents .....   | 5  |
| 1. Introduction .....                                      | 6  |
| 2. Framework of the assessment .....                       | 6  |
| 3. Description of the tested specimen and variations ..... | 7  |
| 3.1 System description .....                               | 7  |
| 3.2 Relevant test data .....                               | 7  |
| 3.3 Purpose of test .....                                  | 8  |
| 3.3.1 Performance criteria .....                           | 8  |
| 3.4 Variations to tested system .....                      | 9  |
| 3.5 Schedule of components .....                           | 15 |
| 4. Scope, objective and assumptions .....                  | 16 |
| 4.1 Scope and objective .....                              | 16 |
| 4.2 Assumptions .....                                      | 16 |
| 5. Assessment 1 – Timber species .....                     | 17 |
| 5.1 Description of variation .....                         | 17 |
| 5.2 Methodology .....                                      | 17 |
| 5.3 Assessment .....                                       | 17 |
| 5.3.1 Raw Flameblock™ FRMDF .....                          | 17 |
| 5.3.2 Natural timber veneers .....                         | 18 |
| 5.3.3 TrueGrain™ reconstituted veneers .....               | 19 |
| 5.3.4 Tabu/Woodstock/Ecoligna™ dyed veneers .....          | 20 |
| 5.4 Conclusion .....                                       | 20 |
| 6. Validity .....  | 21 |
| Appendix A Summary of supporting test data .....           | 22 |
| A.1 Test report – RTF 180222.1 .....                       | 22 |
| A.2 Test report – RTF 190022.1 .....                       | 23 |
| A.3 Test report – RTF 190014.1 .....                       | 24 |
| A.4 Test report – RTF 190015.1 .....                       | 25 |
| A.5 Test report – EWFA 2376600a.1 .....                    | 26 |
| A.6 Test report – EWFA 2376600e.1 .....                    | 27 |
| A.7 Test report – EWFA 2376600c.1 .....                    | 28 |
| A.8 Test report – EWFA 2376600i.1 .....                    | 29 |
| A.9 Test report – EWFA 2376600g.1 .....                    | 30 |

## 1. Introduction

This report documents the findings of the assessment undertaken to determine the likely fire hazard properties of timber veneers bonded to a Flameblock™ FRMDF in accordance with AS 5637.1:2015 and “C/VM2 (Amendment 5) – Verification Method: Framework for Fire Safety Design” of the New Zealand building code. This assessment is carried out at the request of Briggs Veneers Pty Ltd. The client details are included in Table 2.

**Table 2 Client details**

| Client                 | Address  |
|------------------------|--|
| Briggs Veneers Pty Ltd | 409 Victoria Street,<br>Wetherill Park,<br>NSW - 2164.<br>Australia. |

## 2. Framework of the assessment

An assessment is an opinion of the likely performance of a component or element of structure if it were subject to a standard fire test.

No specific framework or methodology, standard or guidance documents exists in Australia for undertaking assessments. Therefore, we have followed the Guide to Undertaking Assessments in Lieu of Fire Tests prepared by the Passive Fire Protection Federation (PFPF) in the UK<sup>1</sup>.

This Guide provides a framework to undertake assessments in the absence of specific fire test results. *‘Some areas where assessments may be offered are:*

- *Where a modification is made to a construction which has already been tested*
- *Interpolation or extrapolation of results of a series of fire resistance tests, or utilisation of a series of fire test results to evaluate a range of variables in a construction design or a product*
- *Where, for various reasons – e.g. size or configuration – it is not possible to subject a construction or a product to a fire test.’*

Assessments will vary from relatively simple judgements on small changes to a product or construction through to a detailed and often complex engineering assessments of large or sophisticated constructions.

---

<sup>1</sup> Guide to Undertaking Assessments In Lieu of Fire Tests - The Passive Fire Protection Federation (PFPF), June 2000, UK.

### 3. Description of the tested specimen and variations

#### 3.1 System description

The system consists of the Flameblock™ FRMDF with or without timber veneers.

#### 3.2 Relevant test data

The assessment of the variation to the tested system to determine its likely performance is based upon the results of the fire test/s documented in the reports summarised in Table 3 and Table 4. Further details of the tested system are described in Appendix A.

**Table 3 Referenced ISO 9705 – 2003 (R2016) test data**

| Report number | Veneer Name          | Veneer Type          | Veneer Density (kg/m <sup>3</sup> ) | Veneer Thickness (mm) | Substrate              |
|---------------|----------------------|----------------------|-------------------------------------|-----------------------|------------------------|
| RTF190014.1   | American White Oak   | Natural              | 755                                 | 0.6                   | 12 mm Flameblock FRMDF |
| RTF190015.1   | TrueGrain Black Onyx | Dyed - Reconstituted | 380                                 | 0.55                  | 12 mm Flameblock FRMDF |
| RTF190022.1   | Grey Ironbark        | Natural              | 1106                                | 0.6                   | 12 mm Flameblock FRMDF |
| RTF180222.1   | Hoop Pine            | Natural              | 530                                 | 0.6                   | 12 mm Flameblock FRMDF |

**Table 4 Referenced AS 3837 – 1998 test data**

| Report number   | Veneer Name          | Veneer Type   | Veneer Density (kg/m <sup>3</sup> ) | Veneer Thickness (mm) | Substrate              |
|-----------------|----------------------|---------------|-------------------------------------|-----------------------|------------------------|
| EWFA 2376600a.1 | -                    | -             | -                                   | -                     | 12 mm Flameblock FRMDF |
| EWFA 2376600e.1 | Radiata Pine         | Natural       | 550                                 | 0.6                   | 12 mm Flameblock FRMDF |
| EWFA 2376600c.1 | Grey Ironbark        | Natural       | 1106                                | 0.6                   | 12 mm Flameblock FRMDF |
| EWFA 2376600i.1 | Truegrain Anthracite | Reconstituted | 415                                 | 0.6                   | 12 mm Flameblock FRMDF |
| EWFA 2376600g.1 | Truegrain Black Onyx | Reconstituted | 380                                 | 0.6                   | 12 mm Flameblock FRMDF |

### 3.3 Purpose of test

AS 5637.1:2015 sets out procedures for the assessment of internal wall and ceiling linings according to their tendency to ignite, release heat, cause flashover, release smoke and contribute to fire growth.

#### 3.3.1 Performance criteria

##### Australia

Specification C1.10 of the National Construction Code 2019 Volume One (NCC) requires materials intended to be used as internal wall and ceiling linings to obtain Group Numbers in accordance with AS 5637.1:2015. The Group Number of a material or a system is based on its 'time to flashover' in the AS ISO 9705 room burn test. The time to flashover is defined as the time required for the heat release rate to reach 1 MW. Below is a description on how a material or a system achieves a certain Group Number:

- Group 1 – Materials classified as Group 1 do not reach flashover after ten minutes exposure to a heat source delivering 100 kW immediately followed by a further ten minutes exposure to 300 kW.
- Group 2 – Materials classified as Group 2 reach flashover after ten minutes of exposure to a 100 kW heat source.
- Group 3 – Material classified as Group 3 reach flashover after two minutes, but before ten minutes of exposure to 100 kW heat source.
- Group 4 – Materials classified as group 4 reach flashover before two minutes of exposure to a 100 kW heat source.

The NCC and AS 5637.1:2015 also define the smoke growth rate index, or  $SMOGR_{RC}$ , as a quantity which may be obtained from the smoke obscuration measurements obtained through the AS ISO 9705:2003 (R2016) test. The  $SMOGR_{RC}$  for a material is obtained by finding the maximum value of the average rate of smoke growth, where the averages are found from the total smoke obscuration determined over intervals of one minute, then dividing that value by the time that maximum occurred and multiplying the result by 1000.

##### New Zealand

New Zealand Ministry of Business, Innovation and Employment's verification method "C/VM2 – (Amendment 5) Verification Method: Framework for Fire Safety Design" provides guidelines on establishing group numbers for lining materials. The framework allows for classification of materials by group number, which indicates the amount of time taken for the material being tested to reach flashover under ISO 9705:1993 test conditions. AS ISO 9705:2003 (R2016) standard states that it is identical to and has been reproduced from ISO 9705:1993, therefore the data obtained from the referenced tests in this report may be still applicable to this assessment.

The Group Number of a material or a system in accordance with Appendix A of C/VM2 is defined by the time taken for the heat release rate as measured during the ISO 9705:1993 test to reach flashover (1 MW) as per the scheme below;

- Group 1 – Materials classified as Group 1 do not reach flashover after ten minutes exposure to a heat source delivering 100 kW immediately followed by a further ten minutes exposure to 300 kW.
- Group 1 – S – Materials that are classified as Group 1-S do not reach flashover after ten minutes exposure to a heat source to a heat source delivering 100 kW immediately followed by a further ten minutes exposure to 300 kW and in addition the average smoke production rate for the period between 0 and 20 minutes of the test period does not exceed  $5.0 \text{ m}^2\text{s}^{-1}$ .
- Group 2 – Materials classified as Group 2 reach flashover after ten minutes of exposure to a 100 kW heat source.



- Group 2 – S – Materials that are classified as Group 2-S do not reach flashover after ten minutes exposure to a heat source delivering 100 kW and in addition the average smoke production rate for the period between 0 and 10 minutes of the test period does not exceed 5.0 m<sup>2</sup>s<sup>-1</sup>.
- Group 3 – Material classified as Group 3 reach flashover after two minutes, but before ten minutes of exposure to 100 kW heat source.
- Group 4 – Materials classified as group 4 reach flashover before two minutes of exposure to a 100 kW heat source.

### 3.4 Variations to tested system

The timber veneer species listed in Table 5 to Table 8 have not been subject to a standard fire test. We have therefore undertaken an assessment of these products based on data collected and analysed from the referenced test reports to predict the likely fire hazard properties of these species.

**Table 5 Natural timber veneers with a maximum thickness and density of 0.6 mm and 755kg/m<sup>3</sup> respectively**

| Preferred Common Name   | Botanical Name                                 | Density (kg/m <sup>3</sup> ) |
|-------------------------|--|------------------------------|
| Acacia, Rose            | <i>Acacia dealbata</i>                         | 655                          |
| Alder, Rose             | <i>Caldcluvia australiensis</i>                | 600                          |
| Anegre                  | <i>Pouteria robusta</i>                        | 550                          |
| Anegre, Figured         | <i>Pouteria spp.</i>                           | 550                          |
| Ash Burr                | <i>Fraxinus excelsior</i>                      | 680                          |
| Ash Olive Burl          | <i>Fraxinus spp.</i>                           | 700                          |
| Ash, Mountain           | <i>Eucalyptus regnans</i>                      | 680                          |
| Ash, Silver             | <i>Flindersia bourjotiana &amp; schottiana</i> | 670                          |
| Ash, Tasmanian          | <i>Eucalyptus regnans</i>                      | 680                          |
| Ash, Victorian          | <i>Eucalyptus regnans</i>                      | 680                          |
| Ash, White              | <i>Fraxinus americana &amp; excelsior</i>      | 690                          |
| Avodire, Figured        | <i>Turraeanthus africanus</i>                  | 575                          |
| Beech, Curly            | <i>Fagus sylvatica</i>                         | 710                          |
| Beech, European         | <i>Fagus sylvatica</i>                         | 710                          |
| Beech, Unsteamed        | <i>Fagus sylvatica</i>                         | 710                          |
| Birch, Australian White | <i>Schizomeria ovata</i>                       | 640                          |
| Birch, Canadian Red     | <i>Betula alleghaniensis</i>                   | 690                          |
| Birch, Curly            | <i>Betula pendula</i>                          | 640                          |
| Birch, European         | <i>Betula pendula</i>                          | 640                          |
| Birch, Masur            | <i>Betula pendula</i>                          | 640                          |
| Birch, Quilted European | <i>Betula pendula</i>                          | 640                          |
| Blackwood, Birds Eye    | <i>Acacia melanoxylon</i>                      | 650                          |
| Blackwood, Tasmanian    | <i>Acacia melanoxylon</i>                      | 650                          |
| Calantas                | <i>Toona calantas</i>                          | 480                          |
| Cherry, American        | <i>Prunus serotina</i>                         | 560                          |
| Cherry, European        | <i>Prunus avium</i>                            | 600                          |
| Cherry, Queensland      | <i>Sloanea australis</i>                       | 600                          |

|  |   |     |
|--|---|-----|
| Coachwood, NSW                                 | <i>Ceratopetalum apetalum</i>                 | 602 |
| Elm Burr                                       | <i>Ulmus carpinifolia &amp; glabra</i>        | 575 |
| Elm, European                                  | <i>Ulmus rubra</i>                            | 600 |
| Elm, Red                                       | <i>Ulmus rubra</i>                            | 600 |
| Eucalypt, Smoked                               | <i>Eucalyptus globulus (plantation only)</i>  | 740 |
| Eucalypt, Tear-drop                            | <i>Eucalyptus delegatensis &amp; regnans</i>  | 650 |
| Fir, Douglas ("Oregon")                        | <i>Pseudotsuga menziesii</i>                  | 550 |
| Gum, Red Heart                                 | <i>Liquidambar styraciflua</i>                | 545 |
| Gum, Rose                                      | <i>Eucalyptus grandis</i>                     | 750 |
| Koto   | <i>Pterygota macrocarpa</i>                   | 595 |
| Leatherwood                                    | <i>Eucryphia billardieri</i>                  | 740 |
| Mahogany, Brazilian                            | <i>Swietenia macrophylla</i>                  | 590 |
| Mahogany, Khaya                                | <i>Khaya sivoensis</i>                        | 568 |
| Mahogany, Pomelle                              | <i>Entandrophragma &amp; Khaya spp.</i>       | 670 |
| Makore   | <i>Tieghemella heckelii</i>                   | 685 |
| Makore, Figured                                | <i>Tieghemella heckelii</i>                   | 685 |
| Makore, Pomelle                                | <i>Tieghemella heckelii</i>                   | 685 |
| Maple Burl                                     | <i>Acer macrophyllum</i>                      | 545 |
| Maple, Birds Eye                               | <i>Acer saccharum</i>                         | 705 |
| Maple, Curly                                   | <i>Acer saccharum</i>                         | 705 |
| Maple, Figured Qld                             | <i>Flindersia brayleyana</i>                  | 560 |
| Maple, Figured Rock                            | <i>Acer saccharum</i>                         | 705 |
| Maple, Queensland                              | <i>Flindersia brayleyana</i>                  | 560 |
| Maple, Quilted                                 | <i>Acer saccharum</i>                         | 705 |
| Maple, Rock                                    | <i>Acer saccharum</i>                         | 705 |
| Meranti  | <i>Shorea spp.</i>                            | 675 |
| Myrtle Burl, American                          | <i>Umbellularia californica</i>               | 635 |
| Myrtle Burr, Tasmanian                         | <i>Nothofagus cunninghamii</i>                | 700 |
| Myrtle, Birdseye                               | <i>Nothofagus cunninghamii</i>                | 700 |
| Myrtle, Figured Tasmanian                      | <i>Nothofagus cunninghamii</i>                | 700 |
| Myrtle, Flame                                  | <i>Nothofagus cunninghamii</i>                | 700 |
| Myrtle, Southern                               | <i>Nothofagus alpina</i>                      | 520 |
| Myrtle, Tasmanian                              | <i>Nothofagus cunninghamii</i>                | 700 |
| Nyatoh   | <i>Palaquium spp.</i>                         | 620 |
| Oak Burr                                       | <i>Quercus robur &amp; petraea &amp; alba</i> | 755 |
| Oak, American White                            | <i>Quercus alba</i>                           | 755 |
| Oak, European                                  | <i>Quercus robur &amp; petraea</i>            | 755 |
| Oak, Figured Tasmanian                         | <i>Eucalyptus delegatensis &amp; regnans</i>  | 650 |
| Oak, Plantation (Plantation Southern Blue Gum) | <i>Eucalyptus globulus (plantation only)</i>  | 740 |
| Oak, Rift                                      | <i>Quercus robur &amp; petraea &amp; alba</i> | 755 |

|                                       |   |     |
|---------------------------------------|---|-----|
| Oak, Silky                            | <i>Cardwellia sublimus</i>                    | 550 |
| Oak, Smoked                           | <i>Quercus robur &amp; petraea &amp; alba</i> | 755 |
| Oak, Tasmanian                        | <i>Eucalyptus delegatensis &amp; regnans</i>  | 650 |
| Padouk                                | <i>Pterocarpus soyauxii</i>                   | 745 |
| Pearwood                              | <i>Pyrus communis</i>                         | 690 |
| Pine, Baltic                          | <i>Pinus sylvestris</i>                       | 550 |
| Pine, Birds Eye                       | <i>Pinus radiata</i>                          | 550 |
| Pine, Celery Top                      | <i>Phyllocladus aspleniifolius</i>            | 645 |
| Pine, Hoop                            | <i>Araucaria cunninghamii</i>                 | 530 |
| Pine, Huon                            | <i>Dacrydium (Lagarostrobos) franklinii</i>   | 560 |
| Pine, Kauri                           | <i>Agathis spp.</i>                           | 540 |
| Pine, Radiata                         | <i>Pinus radiata</i>                          | 550 |
| Rimu, Coloured Heart                  | <i>Dacrydium cupressinum</i>                  | 519 |
| Rimu, Pale                            | <i>Dacrydium cupressinum</i>                  | 519 |
| Rosewood, New Guinea                  | <i>Pterocarpus indicus</i>                    | 593 |
| Sapele                                | <i>Entandrophragma cylindricum</i>            | 670 |
| Sapele, Pomelle                       | <i>Entandrophragma cylindricum</i>            | 670 |
| Sassafras, Black Heart                | <i>Atherosperma moschatum</i>                 | 620 |
| Sassafras, Golden                     | <i>Atherospermia moschatum</i>                | 620 |
| Sen, Japanese                         | <i>Acanthopanax ricinofolus</i>               | 560 |
| Sycamore, Figured                     | <i>Acer pseudoplatanus</i>                    | 615 |
| Sycamore, Queensland                  | <i>Ceratopetalum succirubrum</i>              | 620 |
| Sycamore, White                       | <i>Acer pseudoplatanus</i>                    | 615 |
| Tea Tree                              | <i>Melaleuca leucadendron</i>                 | 745 |
| Vitex                                 | <i>Vitex cofassus</i>                         | 700 |
| Walnut Burr                           | <i>Juglans nigra</i>                          | 610 |
| Walnut, American                      | <i>Juglans nigra</i>                          | 610 |
| Walnut, New Guinea ("Pacific Walnut") | <i>Dracontomelum mangiferum</i>               | 625 |
| Walnut, Queensland                    | <i>Endiandra palmerstonii</i>                 | 680 |
| Walnut, Silky                         | <i>Dillenia spp.</i>                          | 730 |
| Wattle, Silver                        | <i>Acacia dealbata</i>                        | 655 |

**Table 6 TrueGrain reconstituted dyed veneers with maximum thickness and density of 0.55mm and 415 kg/m<sup>3</sup> respectively**

| Preferred Common Name      | Botanical Name                  | Density (kg/m <sup>3</sup> ) |
|----------------------------|---------------------------------|------------------------------|
| TrueGrain Anthracite       | <i>Populus euramericana</i>     | 415                          |
| TrueGrain Biscotti         | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Black Gold       | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Black Onyx       | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Bouchon          | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Burnt Wood       | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Charred Makassar | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Cheri            | <i>Populus euramericana</i>     | 415                          |
| TrueGrain Chocolate        | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Cinder           | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Claret           | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Crema            | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Dove             | <i>Populus euramericana</i>     | 415                          |
| TrueGrain Dusk             | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Ebony Vogue      | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Ghost Ash        | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Heather          | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain HoneySuckle      | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Intense Cocoa    | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Liana            | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Limed Grey Oak   | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Limewood         | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Liquorice        | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Luca             | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Maize            | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Marzipan         | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Mocha            | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Oatmeal          | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Pebble           | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Pinecone         | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Sand             | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Taupe            | <i>Populus euramericana</i>     | 415                          |
| TrueGrain Wenge            | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Zebrano Faso     | <i>Triplochiton scleroxylon</i> | 380                          |
| TrueGrain Zebu             | <i>Triplochiton scleroxylon</i> | 380                          |

**Table 7 TrueGrain reconstituted undyed veneers with maximum thickness and density of 0.6mm and 755 kg/m<sup>3</sup> respectively**

| Preferred Common Name       | Botanical Name                                 | Density (kg/m <sup>3</sup> ) |
|-----------------------------|--|------------------------------|
| TrueGrain American Walnut   | <i>Juglans nigra</i>                           | 610                          |
| TrueGrain Blackbutt         | <i>Eucalyptus pilularis</i>                    | 900                          |
| TrueGrain Blackwood         | <i>Acacia melanoxylon</i>                      | 650                          |
| TrueGrain European Birch    | <i>Betula pendula</i>                          | 640                          |
| TrueGrain Hoop Pine         | <i>Araucaria cunninghamii</i>                  | 530                          |
| TrueGrain Jarrah            | <i>Eucalyptus marginata</i>                    | 820                          |
| TrueGrain Mountain Ash      | <i>Eucalyptus regnans</i>                      | 680                          |
| TrueGrain Pacifica          | <i>Dracontomelum mangiferum</i>                | 625                          |
| TrueGrain Queensland Cherry | <i>Sloanea australis</i>                       | 600                          |
| TrueGrain Rift Oak          | <i>Quercus alba</i>                            | 755                          |
| TrueGrain Silky Oak         | <i>Cardwellia sublimus</i>                     | 550                          |
| TrueGrain Silver Ash        | <i>Flindersia bourjotiana &amp; schottiana</i> | 670                          |
| TrueGrain Silver Beech      | <i>Nothofagus menziesii</i>                    | 705                          |
| TrueGrain Southern Myrtle   | <i>Nothofagus alpina</i>                       | 520                          |
| TrueGrain Tasmanian Ash     | <i>Eucalyptus regnans</i>                      | 680                          |
| TrueGrain Tasmanian Oak     | <i>Eucalyptus delegatensis &amp; regnans</i>   | 650                          |

**Table 8 Tabu/Woodstock/Ecoligna dyed veneers with a maximum thickness and density of 0.6 mm and 755 kg/m<sup>3</sup> respectively**

| Preferred Common Name                   | Botanical Name                                | Density (kg/m <sup>3</sup> ) |
|---|---|------------------------------|
| Ecoligna Raven                          | <i>Quercus robur &amp; petraea &amp; alba</i> | 755                          |
| Ecoligna Shale                          | <i>Liriodendron tulipifera</i>                | 455                          |
| Tabu American Cherry (all colours)      | <i>Prunus serotina</i>                        | 560                          |
| Tabu American Walnut (all colours)      | <i>Juglans nigra</i>                          | 610                          |
| Tabu American Walnut Burl (all colours) | <i>Juglans nigra</i>                          | 610                          |
| Tabu Anegre (all colours)               | <i>Pouteria altissima</i>                     | 550                          |
| Tabu Ash (all colours)                  | <i>Fraxinus excelsior</i>                     | 680                          |
| Tabu Birch (all colours)                | <i>Betula pendula</i>                         | 640                          |
| Tabu Birds Eye Maple (all colours)      | <i>Acer saccharum</i>                         | 705                          |
| Tabu Elm (all colours)                  | <i>Ulmus cglabra</i>                          | 575                          |
| Tabu Eucalypt (all colours)             | <i>Eucalyptus globulus (plantation only)</i>  | 740                          |
| Tabu European Walnut Burl (all colours) | <i>Juglans regia</i>                          | 640                          |
| Tabu Lacewood (all colours)             | <i>Panopsis spp.</i>                          | 530                          |
| Tabu Larch (all colours)                | <i>Larix spp.</i>                             | 575                          |
| Tabu Oak (all colours)                  | <i>Quercus robur &amp; petraea &amp; alba</i> | 755                          |
| Tabu Pine (all colours)                 | <i>Pinus rigida</i>                           | 545                          |
| Tabu Pomelle Eucalypt (all colours)     | <i>Eucalyptus globulus (plantation only)</i>  | 740                          |

|                                   |   |     |
|-----------------------------------|---|-----|
| Tabu Pomelle Makore (all colours) | <i>Tieghemella heckelii</i>                   | 685 |
| Tabu Quilted Maple (all colours)  | <i>Acer saccharum</i>                         | 705 |
| Tabu Rock Maple (all colours)     | <i>Acer saccharum</i>                         | 705 |
| Tabu Sycamore (all colours)       | <i>Acer saccharinum &amp; rubrum</i>          | 705 |
| Tabu Tay (all colours)            | <i>Pterygota macrocarpa</i>                   | 595 |
| Tabu Tulipwood (all colours)      | <i>Liriodendron tulipifera</i>                | 455 |
| Woodstock Aubergine Tay           | <i>Pterygota macrocarpa</i>                   | 595 |
| Woodstock Black Tulipwood         | <i>Liriodendron tulipifera</i>                | 455 |
| Woodstock Brown Ash               | <i>Fraxinus excelsior</i>                     | 680 |
| Woodstock Charcoal Tay            | <i>Pterygota macrocarpa</i>                   | 595 |
| Woodstock Chocolate Tay           | <i>Pterygota macrocarpa</i>                   | 595 |
| Woodstock Dutch Tulipwood         | <i>Liriodendron tulipifera</i>                | 455 |
| Woodstock Flinders Oak            | <i>Quercus robur &amp; petraea &amp; alba</i> | 755 |
| Woodstock Ghost Anegre            | <i>Pouteria altissima</i>                     | 550 |
| Woodstock Grey Birch              | <i>Betula pendula</i>                         | 640 |
| Woodstock Gunmetal Birch          | <i>Betula pendula</i>                         | 640 |
| Woodstock Lichen Tulipwood        | <i>Liriodendron tulipifera</i>                | 455 |
| Woodstock Macchiato Tay           | <i>Pterygota macrocarpa</i>                   | 595 |
| Woodstock Mocha Tay               | <i>Pterygota macrocarpa</i>                   | 595 |
| Woodstock Naples Ash              | <i>Fraxinus excelsior</i>                     | 680 |
| Woodstock Pewter Oak              | <i>Quercus robur &amp; petraea &amp; alba</i> | 755 |
| Woodstock Platinum Ash            | <i>Fraxinus excelsior</i>                     | 680 |
| Woodstock Spanish Tulipwood       | <i>Liriodendron tulipifera</i>                | 455 |

### 3.5 Schedule of components

This section outlines the schedule of components of the assessed system/s subject to a fire test referenced in Appendix A.

**Table 9 Schedule of components of assessed systems**

| Item           |                           | Description  |
|----------------|---------------------------|--|
| <b>Lining</b>  |                           |  |
| 1.             | Product name              | Timber veneer on 12mm FLAMEBLOCK™ FRMDF  |
|                | Material                  | Natural pale-brown coloured Fire Retardant MDF (FR MDF). Briggs Flameblock FR MDF is made primarily from softwood (gymnosperm) wood fibres with up to 5% hardwood (angiosperm) wood fibres. The wood fibres are bonded together with melamine-urea-formaldehyde (MUF) adhesive. Fire retardancy is imparted by phosphate and other inorganic salts in the proportion 9% to 10% by weight. The veneer was adhered to the MDF using heat-cured crosslinked PVA.  |
|                | Measured uncut sheet size | 2400mm x 1200mm x 13.5mm thick (measured)<br>(12mm thick Flameblock sandwiched in between two layers of 0.55-0.6 mm thick veneer, as nominated by the client)  |
|                | Installation              | The MDF boards were screw fixed to the room walls and ceiling using plasterboard screws (item 2). The ceiling panels were installed first, followed by the rear wall panels and lastly the right and left walls. The ceiling was installed with the full width and length panels. Three rows of screws were used, one through the centre of the panels lengthwise and on both sides. Fixings were at 600mm centres, with a 50mm offset from the edges. The wall panels were trimmed by 14mm to allow for the ceiling panel thickness. The same screw centres were used, with a 50mm offset from the edges of the panels. |
| <b>Fixings</b> |                           |  |
| 2.             | Product name              | #8 x 65mm Needle point fine thread plasterboard screw  |
|                | Installation              | Used to screw fix the panels (item 1) to the room walls and ceiling. Screw holes were pre-drilled.   |

## 4. Scope, objective and assumptions

### 4.1 Scope and objective

- This assessment is performed in accordance with requirements of AS ISO 9705 – 2003 (R2016) and AS 5637.1:2015 with the purpose of determining group numbers using classification schemes given in AS 5637.1:2015 and “C/VM2 – Verification Method: Framework for Fire Safety Design” of the New Zealand building code.
- The scope of this report is limited to the variations to the tested systems described in section 3.4.
- This report applies to flat un-slotted, non-routed panels only.
- Any changes to the veneer thickness, glue type, glue layer thickness, substrates or fixing methods other than those identified in this report, may invalidate the findings of this assessment. A separate test or assessment has to be carried out to validate those changes.
- The data, methodologies, calculations and conclusions documented in this report specifically relate to the assessed system/s and must not be used for any other purpose.

### 4.2 Assumptions

- This report has been prepared based on information provided by others. Warringtonfire has not verified the accuracy and/or completeness of this information and will not be responsible for any errors or omissions that may be incorporated into this report as a result.
- The system, component or element of structure has not been subjected to the standard fire test against which this assessment is being made.



## 5. Assessment 1 – Timber species

### 5.1 Description of variation

The group number of a material or a system is based on its ‘time to flashover’ in the AS ISO 9705 room burn test. Flashover usually occurs when the fire is fully developed and all combustible items in the room are involved in the fire. In AS 5637.1:2015, flashover is said to occur when the total heat release rate exceeds 1MW (1000 kW). The fire hazard properties of timber are dependent on multiple factors such as density, thickness, microstructure and chemical composition. For veneered timber materials, additional factors such as the type and thickness of the adhesive layer also contribute to the fire.

This assessment report investigates the influence of veneer density on the overall fire hazard properties of the veneered Flameblock™ FRMDF when used as a wall and ceiling lining material.

Timber is a non-homogeneous and non-isotropic material which is made from a mixture of complex natural polymers of high molecular weight such as cellulose, hemicellulose and lignin. The density of a timber species depends on the corresponding relative polymeric content and its microstructure (permeability). Hence, the critical parameter used to define the fire hazard properties of the veneered Flameblock™ FRMDF in this assessment is veneer density. All other parameters such as moisture content, veneer thickness, adhesive type and adhesive thickness are kept constant. The effect of these variables is outside the scope of this assessment.

### 5.2 Methodology

The approach and method used for this assessment to meet the requirements of the referenced standard is summarised in Table 10.

**Table 10 Method of assessment**

| Assessment approach              |   |
|----------------------------------|---|
| Level of complexity <sup>2</sup> | Intermediate assessment                     |
| Type of assessment               | Quantitative – interpolation<br>Comparative |

### 5.3 Assessment

#### 5.3.1 Raw Flameblock™ FRMDF

The effect of timber veneers on the fire hazard properties of the Flameblock™ FRMDF was established through small-scale cone testing in accordance with AS/NZS 3837 – 1998. Critical parameters such as heat release rates, mass loss and smoke production were measured.

As summarized in Table 11, the fire hazard properties of the raw Flameblock™ FRMDF were consistently better than the veneered counterparts. The absence of timber veneers and adhesives on the surface of the FRMDF resulted in a significant drop in the heat release rates and the corresponding smoke production. The timber veneers not only acted as an additional fuel source, but also hindered the efficient release of non-volatile gases released from the FRMDF. A similar behaviour is expected if these materials are tested under room burn conditions. It is therefore expected that the Flameblock FRMDF (minimum thickness of 12 mm) will achieve at least Group 2.

<sup>2</sup> Guide to Undertaking Assessments In Lieu of Fire Test - The Passive Fire Protection Federation (PFPF), June 2000, UK.

**Table 11 Effect of timber veneers on the fire hazard properties of the Flameblock™ FRMDF**


| Veneer                       | Substrate               | Peak HRR (kW/m <sup>2</sup> ) | Average HRR at 180s (kW/m <sup>2</sup> ) | Average Effective Heat of Combustion (MJ/kg) |
|------------------------------|-------------------------|-------------------------------|--|--|
| -                            | 12 mm Flameblock™ FRMDF | 91.2                          | 22.4                                     | 1.6  |
| 0.6 mm Radiata Pine          | 12 mm Flameblock™ FRMDF | 157                           | 42.6                                     | 4.3  |
| 0.6 mm Grey Ironbark         | 12 mm Flameblock™ FRMDF | 191.5                         | 53.6                                     | 4.5  |
| 0.6 mm Truegrain™ Anthracite | 12 mm Flameblock™ FRMDF | 177.9                         | 39.7                                     | 3.9  |
| 0.6 mm Truegrain™ Black Onyx | 12 mm Flameblock™ FRMDF | 159.7                         | 41.0                                     | 4.0  |

### 5.3.2 Natural timber veneers

Multiple ISO 9705 room burn tests were conducted on the Flameblock™ FRMDF with different hardwood and softwood species veneers, the results of which are shown in Figure 1 and Figure 2.

#### Hardwood

As shown in Figure 1, two peaks were observed for both hardwood species. However, the magnitude of the first peak is significantly higher for the Grey Ironbark (~1050 kW) than the American White Oak (< 500 kW). The room lined with Grey Ironbark veneered FRMDF went into flashover in approximately 6 minutes, thereby achieving Group 3. The room lined with the American White Oak veneered FRMDF went into flashover when the burner output was increased to 300 KW at 12 minutes, thereby achieving Group 2.

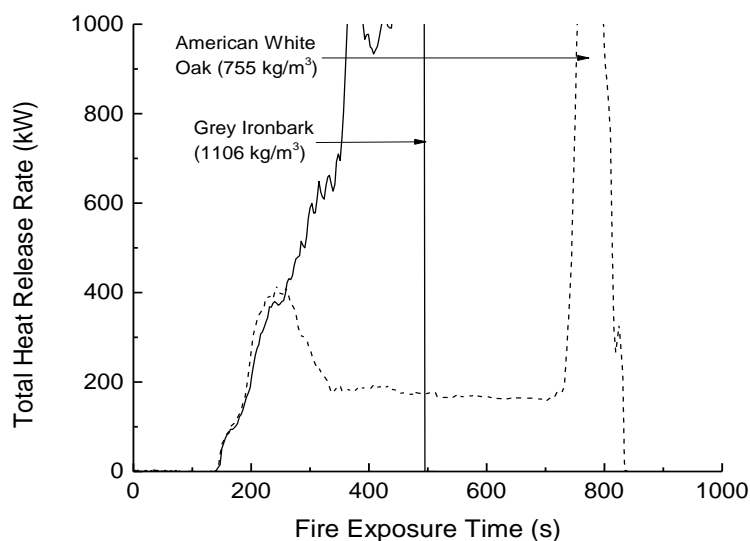

**Figure 1 Total heat release rates of hardwood natural timber veneers adhered to the Flameblock™ FRMDF when tested in accordance with AS ISO 9705 – 2003 (R2016)**


The thermally thin nature of the Grey Ironbark ( $1106 \text{ kg/m}^3$ ) veneer and its higher density resulted in a rapid flame spread and heat release in the first few minutes of the test eventually leading to flashover. Large amounts of highly flammable hydrocarbon volatiles are released in a very short time and therefore become fuel to sustain the fire.

Similar behaviour was not observed for the American White Oak ( $755 \text{ kg/m}^3$ ) with the same veneer thickness. The rate of heat release was significantly lower in the first few minutes, which gave enough time for the flame retardants embedded within the FRMDF to activate. The activation of the flame retardants was most likely in the gaseous phase by interfering with the combustion reaction, thus reducing both flame propagation and the amount of heat returned from the fire to the material.

### Softwood

The heat release rates of the Hoop Pine (softwood) veneered FRMDF was similar to the American White Oak. However, the magnitude of the first peak was slightly greater for the Hoop Pine, possibly due to the greater porosity. The difference was still not significant enough for the system to achieve flashover in the first 10 minutes of burn time. The product achieved a rating of Group 2.

Based on the above discussion, it can be concluded that all softwood and hardwood veneers up to  $750 \text{ kg/m}^3$  will likely achieve Group 2 when tested in accordance with AS 5637.1:2015 and AS ISO 9705 – 2003 (R2016).

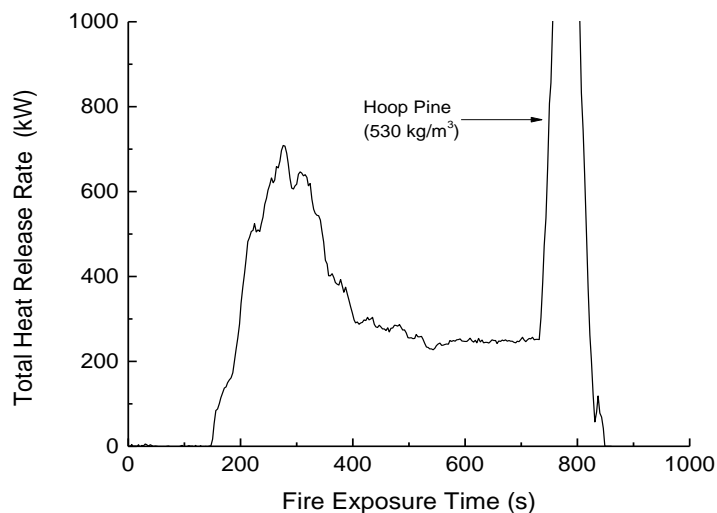

**Figure 2** Total heat release rates of softwood (Hoop Pine) veneer adhered to the Flameblock™ FRMDF when tested in accordance with AS ISO 9705 - 2003

### 5.3.3 TrueGrain™ reconstituted veneers

Reconstituted veneers are made from natural timber veneers which are dyed, laminated and re-sliced. All dyed reconstituted veneers listed in Table 6 are made from Poplar and Ayous and have similar densities (between  $380 - 415 \text{ kg/m}^3$ ). The dye percentage in all reconstituted veneers is confirmed by the sponsor of this report to be less than 1 wt%.


An ISO 9705 room burn test was conducted on the TrueGrain™ Black Onyx veneer adhered to the Flameblock™ FRMDF. This veneer was chosen for its dark colour, thereby making it the worst-case scenario due to its ability to absorb more heat. The density of the veneer was measured to be  $380 \text{ kg/m}^3$ . Cone tests performed on the TrueGrain™ Anthracite ( $415 \text{ kg/m}^3$ ) and the TrueGrain™ Black Onyx showed no significant differences in the fire hazard properties - see Table 11.

As shown in Figure 3, the magnitude of the first peak was less than 400 kW. The room did not go into flashover until after the burner output was increased to 300 kW, thereby achieving Group 2. It is therefore expected that all other dyed reconstituted veneers listed in Table 6 will perform similarly under room burn conditions.

The un-dyed reconstituted veneers consist of primarily natural timber (up to  $990 \text{ kg/m}^3$ ) that are laminated and re-sliced. The polymeric content in these veneers is negligible and hence is expected not to detrimentally affect their respective fire hazard properties. It can therefore be concluded that the performance of un-dyed veneers listed in Table 7 are expected to perform similar to the natural timber veneers of the same density.

### 5.3.4 Tabu/Woodstock/Ecoligna™ dyed veneers

These veneers are made from natural timber which are treated with a dye to improve colour consistency when compared to the undyed veneers. The dye percentage in all reconstituted veneers is confirmed by the sponsor of this report to be less than 1 wt%. It can therefore be concluded that the performance of un-dyed veneers listed in Table 8 are expected to perform similar to the natural timber veneers of the same density.

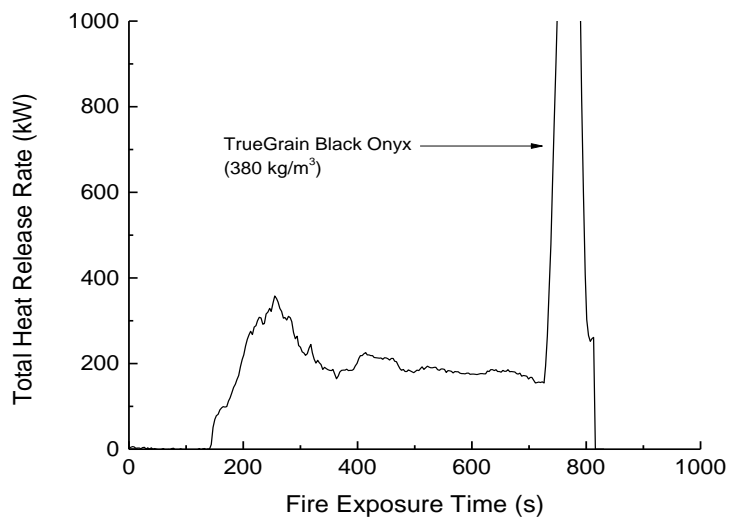

**Figure 3** Total heat release rates of TrueGrain™ Black Onyx reconstituted dyed veneer adhered to the Flameblock FRMDF when tested in accordance with AS ISO 9705 – 2003 (R2016)

## 5.4 Conclusion

Based on the above discussion, it is expected that the raw Flameblock™ FRMDF with a minimum thickness of 12 mm will achieve at least Group 2. All veneer species with a density up to  $750 \text{ kg/m}^3$  bonded to a Flameblock™ FRMDF are also likely to achieve Group 2.

## 6. Validity

Warringtonfire Australia does not endorse the tested or assessed product in any manner. The conclusions of this assessment may be used to directly assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of fire hazard under all conditions.

Due to the nature of fire testing and the consequent difficulty in quantifying the uncertainty of measurement, it is not possible to provide a stated degree of accuracy. The inherent variability in test procedures, materials and methods of construction, and installation may lead to variations in performance between elements of similar construction.

This assessment is based on information and experience available at the time of preparation. The published procedures for the conduct of tests and the assessment of test results are subject to constant review and improvement. It is therefore recommended that this report be reviewed on or before, the stated expiry date.

This assessment represents our opinion as to the performance likely to be demonstrated on a test in accordance with AS 5637.1:2015, on the basis of the evidence referred to above. We express no opinion as to whether that evidence, and/or this assessment, would be regarded by any building certifier as sufficient for that or any other purpose. This assessment is provided to Briggs Veneers Pty Ltd for its own purposes and we cannot opine on whether it will be accepted by building certifiers or any other third parties for any purpose.

## Appendix A Summary of supporting test data

### A.1 Test report – RTF 180222.1

Table 12 Information relating to test report

| Item                                   | Information relating to test report   |
|--|---|
| Report sponsor                         | Briggs Veneers Pty Ltd  |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.  |
| Test date                              | The test was conducted on 18 December 2018.   |
| Test standards                         | The test was conducted in accordance with AS 5637.1:2015 and AS ISO 9705 - 2003.  |
| Variation to test standards            | None  |
| General description of tested specimen | The ISO 9705 room burn test consisted of walls and ceilings lined with a Hoop Pine (natural timber) veneer bonded to the Flameblock™ FRMDF with PVA glue. |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS ISO 9705 - 2003.  |

The results achieved by the test specimen is outlined below.

Table 13 Results summary of test report

| Group Number | SMOGR <sub>RC</sub><br>(m <sup>2</sup> s <sup>-2</sup> × 1000) | Average Smoke Production Rate (0-10 mins)<br>(m <sup>2</sup> s <sup>-1</sup> ) |
|--------------|--|--|
| 2            | 4.7  | 0.77   |

## A.2 Test report – RTF 190022.1

**Table 14** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 8 February 2019.   |
| Test standards                         | The test was conducted in accordance with AS 5637.1:2015 and AS ISO 9705 - 2003.   |
| Variation to test standards            | None   |
| General description of tested specimen | The ISO 9705 room burn test consisted of walls and ceilings lined with a Grey Ironbark (natural timber) veneer bonded to the Flameblock™ FR MDF with PVA glue. |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS ISO 9705 - 2003.   |

The results achieved by the test specimen is outlined below.

**Table 15** Results summary of test report

| Group Number | SMOGR <sub>ARC</sub><br>(m <sup>2</sup> s <sup>-2</sup> × 1000) | Average Smoke Production Rate (0-10 mins)<br>(m <sup>2</sup> s <sup>-1</sup> ) |
|--------------|---|--|
| 3            | 28.9  | 1.68   |

### A.3 Test report – RTF 190014.1

**Table 16** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 2 April 2019.  |
| Test standards                         | The test was conducted in accordance with AS 5637.1:2015 and AS ISO 9705 - 2003.   |
| Variation to test standards            | None   |
| General description of tested specimen | The ISO 9705 room burn test consisted of walls and ceilings lined with a TrueGrain™ Black Onyx (reconstituted dyed timber) veneer bonded to the Flameblock™ FRMDF with PVA glue. |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS ISO 9705 - 2003.   |

The results achieved by the test specimen is outlined below.

**Table 17** Results summary of test report

| Group Number | SMOGR <sub>RC</sub><br>(m <sup>2</sup> s <sup>-2</sup> × 1000) | Average Smoke Production Rate (0-10 mins)<br>(m <sup>2</sup> s <sup>-1</sup> ) |
|--------------|--|--|
| 2            | 10.3   | 0.33   |



## A.4 Test report – RTF 190015.1

**Table 18** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 3 April 2019.  |
| Test standards                         | The test was conducted in accordance with AS 5637.1:2015 and AS ISO 9705 - 2003.   |
| Variation to test standards            | None   |
| General description of tested specimen | The ISO 9705 room burn test consisted of walls and ceilings lined with a American White Oak (natural timber) veneer bonded to the Flameblock™ FRMDF with PVA glue. |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS ISO 9705 - 2003.   |

The results achieved by the test specimen is outlined below.

**Table 19** Results summary of test report

| Group Number | SMOGR <sub>ARC</sub><br>(m <sup>2</sup> s <sup>-2</sup> × 1000) | Average Smoke Production Rate (0-10 mins)<br>(m <sup>2</sup> s <sup>-1</sup> ) |
|--------------|---|--|
| 2            | 5.8   | 0.28   |

## A.5 Test report – EWFA 2376600a.1

**Table 20** Information relating to test report

| Item                                   | Information relating to test report   |
|--|---|
| Report sponsor                         | Briggs Veneers Pty Ltd  |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.  |
| Test date                              | The test was conducted on 17 August 2009.   |
| Test standards                         | The test was conducted in accordance with AS/NZS 3837 - 1998.   |
| Variation to test standards            | None  |
| General description of tested specimen | The small-scale cone calorimetry test was conducted on the raw Flameblock™ FRMDF at an incident radiant heat flux of 50 kW/m <sup>2</sup> . |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS/NZS 3837 - 1998.  |

**Table 21** Results summary of test report

| Property                                    | Mean Value       | Units               |
|---|------------------|---------------------|
| Irradiance                                  | 50               | kW/m <sup>2</sup>   |
| Exhaust flow rate                           | 24               | l/s                 |
| Time to ignition                            | Failed to ignite | s                   |
| Peak heat release rate (HRR) after ignition | 91.2             | kW/m <sup>2</sup>   |
| Average HRR at 60s                          | 32.3             | kW/m <sup>2</sup>   |
| Average HRR at 180s                         | 22.4             | kW/m <sup>2</sup>   |
| Average HRR at 300s                         | 16.5             | kW/m <sup>2</sup>   |
| Total heat released                         | 8.1              | MJ/m <sup>2</sup>   |
| Average effective heat of combustion        | 1.6              | MJ/kg               |
| Mass percentage pyrolyzed                   | 47.7             | %                   |
| Average mass loss rate                      | 8.4              | g/m <sup>2</sup> /s |

## A.6 Test report – EWFA 2376600e.1

**Table 22** Information relating to test report

| Item                                   | Information relating to test report   |
|--|---|
| Report sponsor                         | Briggs Veneers Pty Ltd  |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.  |
| Test date                              | The test was conducted on 17 August 2009.   |
| Test standards                         | The test was conducted in accordance with AS/NZS 3837 - 1998.   |
| Variation to test standards            | None  |
| General description of tested specimen | The small-scale cone calorimetry test was conducted on a Radiata Pine veneer bonded to the Flameblock™ FRMDF at an incident radiant heat flux of 50 kW/m <sup>2</sup> . |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS/NZS 3837 - 1998.  |

**Table 23** Results summary of test report

| Property                                    | Mean Value | Units               |
|---|------------|---------------------|
| Irradiance                                  | 50         | kW/m <sup>2</sup>   |
| Exhaust flow rate                           | 24         | l/s                 |
| Time to ignition                            | 23         | s                   |
| Peak heat release rate (HRR) after ignition | 157        | kW/m <sup>2</sup>   |
| Average HRR at 60s                          | 96         | kW/m <sup>2</sup>   |
| Average HRR at 180s                         | 42         | kW/m <sup>2</sup>   |
| Average HRR at 300s                         | N/A        | kW/m <sup>2</sup>   |
| Total heat released                         | 7.8        | MJ/m <sup>2</sup>   |
| Average effective heat of combustion        | 4.3        | MJ/kg               |
| Mass percentage pyrolyzed                   | 16.4       | %                   |
| Average mass loss rate                      | 9.5        | g/m <sup>2</sup> /s |

## A.7 Test report – EWFA 2376600c.1

**Table 24** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 17 August 2009.  |
| Test standards                         | The test was conducted in accordance with AS/NZS 3837 - 1998.  |
| Variation to test standards            | None   |
| General description of tested specimen | The small-scale cone calorimetry test was conducted on a Grey Ironbark veneer bonded to the Flameblock™ FRMDF at an incident radiant heat flux of 50 kW/m <sup>2</sup> . |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS/NZS 3837 - 1998.   |

**Table 25** Results summary of test report

| Property                                    | Mean Value | Units               |
|---|------------|---------------------|
| Irradiance                                  | 50         | kW/m <sup>2</sup>   |
| Exhaust flow rate                           | 24         | l/s                 |
| Time to ignition                            | 19         | s                   |
| Peak heat release rate (HRR) after ignition | 191.5      | kW/m <sup>2</sup>   |
| Average HRR at 60s                          | 109        | kW/m <sup>2</sup>   |
| Average HRR at 180s                         | 53.6       | kW/m <sup>2</sup>   |
| Average HRR at 300s                         | N/A        | kW/m <sup>2</sup>   |
| Total heat released                         | 10.2       | MJ/m <sup>2</sup>   |
| Average effective heat of combustion        | 4.5        | MJ/kg               |
| Mass percentage pyrolyzed                   | 19.5       | %                   |
| Average mass loss rate                      | 10.5       | g/m <sup>2</sup> /s |

## A.8 Test report – EWFA 2376600i.1

**Table 26** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 17 August 2009.  |
| Test standards                         | The test was conducted in accordance with AS/NZS 3837 - 1998.  |
| Variation to test standards            | None   |
| General description of tested specimen | The small-scale cone calorimetry test was conducted on a TrueGrain™ Anthracite veneer bonded to the Flameblock™ FRMDF at an incident radiant heat flux of 50 kW/m <sup>2</sup> . |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS/NZS 3837 - 1998.   |

**Table 27** Results summary of test report

| Property                                    | Mean Value | Units               |
|---|------------|---------------------|
| Irradiance                                  | 50         | kW/m <sup>2</sup>   |
| Exhaust flow rate                           | 24         | l/s                 |
| Time to ignition                            | 24         | s                   |
| Peak heat release rate (HRR) after ignition | 177.9      | kW/m <sup>2</sup>   |
| Average HRR at 60s                          | 89.7       | kW/m <sup>2</sup>   |
| Average HRR at 180s                         | 39.7       | kW/m <sup>2</sup>   |
| Average HRR at 300s                         | 27.1       | kW/m <sup>2</sup>   |
| Total heat released                         | 7.3        | MJ/m <sup>2</sup>   |
| Average effective heat of combustion        | 3.9        | MJ/kg               |
| Mass percentage pyrolyzed                   | 16.8       | %                   |
| Average mass loss rate                      | 9.5        | g/m <sup>2</sup> /s |

## A.9 Test report – EWFA 2376600g.1

**Table 28** Information relating to test report

| Item                                   | Information relating to test report  |
|--|--|
| Report sponsor                         | Briggs Veneers Pty Ltd   |
| Test laboratory                        | Warringtonfire Australia, Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175, Australia.   |
| Test date                              | The test was conducted on 17 August 2009.  |
| Test standards                         | The test was conducted in accordance with AS/NZS 3837 - 1998.  |
| Variation to test standards            | None   |
| General description of tested specimen | The small-scale cone calorimetry test was conducted on a TrueGrain™ Black Onyx veneer bonded to the Flameblock™ FRMDF at an incident radiant heat flux of 50 kW/m <sup>2</sup> . |
| Instrumentation                        | The test report states that the instrumentation was in accordance with AS/NZS 3837 - 1998.   |

**Table 29** Results summary of test report

| Property                                    | Mean Value | Units               |
|---|------------|---------------------|
| Irradiance                                  | 50         | kW/m <sup>2</sup>   |
| Exhaust flow rate                           | 24         | l/s                 |
| Time to ignition                            | 16         | s                   |
| Peak heat release rate (HRR) after ignition | 159.7      | kW/m <sup>2</sup>   |
| Average HRR at 60s                          | 83.9       | kW/m <sup>2</sup>   |
| Average HRR at 180s                         | 41.0       | kW/m <sup>2</sup>   |
| Average HRR at 300s                         | N/A        | kW/m <sup>2</sup>   |
| Total heat released                         | 7.4        | MJ/m <sup>2</sup>   |
| Average effective heat of combustion        | 4.0        | MJ/kg               |
| Mass percentage pyrolyzed                   | 16.5       | %                   |
| Average mass loss rate                      | 9.9        | g/m <sup>2</sup> /s |